



SULLIVAN COUNTY RURAL ELECTRIC COOPERATIVE, INC.


P. O. BOX 65, ROUTE 87
FORKSVILLE, PENNSYLVANIA 18616
(570) 924 - 3381 www.screc.com

INSTALLATION REQUIREMENTS FOR UNDERGROUND PEDESTAL MOUNTED SERVICES FOR MOBILE HOMES AND DOUBLE-WIDE APPLICATIONS

IMPORTANT:

ALL INSTALLATIONS MUST BE INSPECTED AND APPROVED BY A RECOGNIZED INSPECTION AGENCY BEFORE THE SERVICE CAN BE ENERGIZED.

ALL INSTALLATIONS TO BE IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE. SEE "SPECIFICATIONS FOR UNDERGROUND SERVICE INSTALLATION" FOR TRENCH REQUIREMENTS

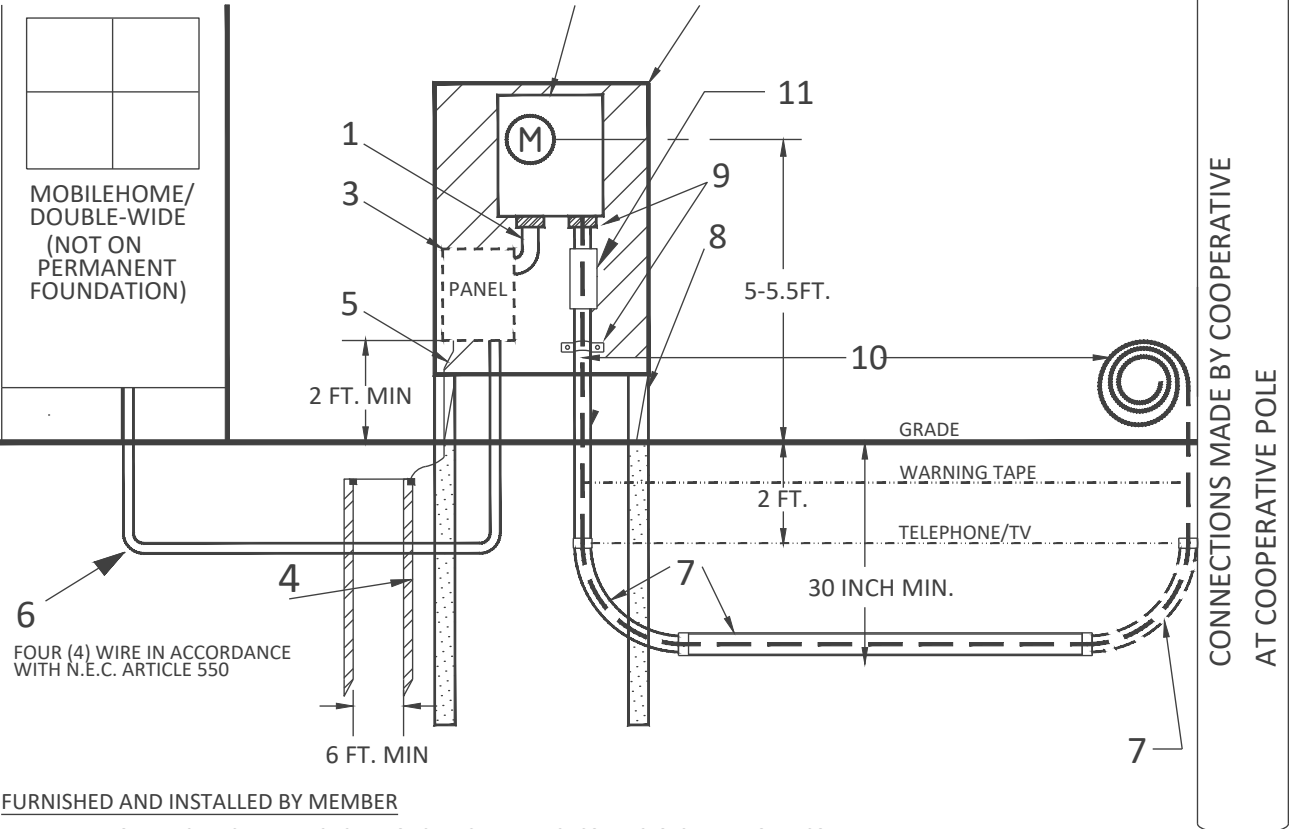

FURNISHED AND INSTALLED BY MEMBER

- 1 MEMBER OWNED SERVICE ENTRANCE CABLE OR SERVICE ENTRANCE CONDUCTORS IN APPROVED CONDUIT.
200 AMP - 4/0 ALUMINIUM OR 2/0 COPPER. INHIBITOR COMPOUND USED ON ALL ALUMINUM WIRE TERMINATIONS.
400 AMP - 600 MCM ALUMINIUM OR 400 MCM COPPER.
- 2 MEMBER OWNED 4 JAW UL APPROVED RINGLESS TYPE OFFSET METERBASE WITH WEATHER TIGHT HUBS AND BY-PASS HORNS. 200 AMP. MINIMUM. DO NOT USE BOTTOM CENTER KNOCKOUT. SEE N.E.C. ARTICLE 230.7 (A) (B)
- 3 MEMBER OWNED SERVICE EQUIPMENT - MINIMUM 200 AMP WITH 6 BREAKER SPACES MINIMUM. NEMA 3R OUTDOOR TYPE. MUST BE LABELED "EMERGENCY DISCONNECT" ON THE OUTSIDE FRONT OF THE ENCLOSURE WITH RED BACKGROUND AND WHITE LETTERS. AT LEAST 1/2 LETTERS. SEE N.E.C. ARTICLE 230.7 (A) (B).
- 4 TWO (2) 5/8 INCH x 8 FOOT COPPERWELD OR GALVANIZED GROUND RODS.
- 5 GROUND WIRE #4 BARE COPPER FOR A 200 AMP INSTALLATION WHERE AVAILABLE.
SERVICE SHOULD ALSO BE GROUNDED TO WELL CASING OR UNDERGROUND METALLIC WATER PIPING SYSTEM.
GAS OR FUEL OIL PIPING SHALL NOT BE USED AS A GROUNDING ELECTRODE. BONDING: SEE N.E.C. ARTICLE 250
- 6 CONDUIT WITH 4 WIRE CABLE.
- 7 3 INCH SCHEDULE 40 PVC ELECTRICAL CONDUIT WITH (2) SCHEDULE 40 PVC 24 INCH MINIMUM RADIUS SWEEPS.
- 8 3/4 INCH EXTERIOR PLYWOOD OR EQUIVALENT IN STRENGTH PRESSURE TREATED LUMBER WITH MINIMUM 4 INCH X 4 INCH TREATED TIMBERS AT A DEPTH OF 48 INCHES (4 FT.)
- 9 3 INCH STANDARD THREADED CONNECTOR ASSEMBLY. 3 INCH ELECTRICAL GRADE CONDUIT SCHEDULE 40 MINIMUM ABOVE GRADE AND 2 HOLE STRAPS WITH A 1/4 INCH WEEP HOLE DRILLED 6 INCHES ABOVE GROUND LEVEL.
- 10 1/4 INCH NYLON PULL ROPE. TIE PULL ROPE OFF AT BOTH ENDS TO PREVENT ROPE FROM PULLING OUT OF CONDUIT.
- 11 3" EXPANSION FITTING.